


Pageant CODESYS

Quick Start Guide

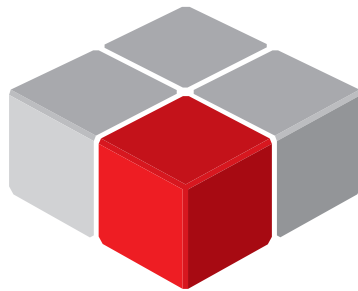

CODESYS

This manual describes how to setup the CODESYS v3 environment to work with the BEKA Pageant Operator Panel and start developing PLC applications.

This manual is not intended as a CODESYS V3 programming manual, for detailed documentation regarding CODESYS V3 Development System please refer to the CODESYS web site <https://www.codesys.com> and to and to its on-line help.

Contents

- [1 Software Requirements](#)
- [2 CODESYS V3 Development System Installation](#)
- [3 BEKA CODESYS Package Installation](#)
- [4 Creation of a new PLC Project](#)
- [5 Adding I/O Modules to the project](#)
- [6 Display Keys and LEDs](#)
- [7 Downloading PLC applications](#)
- [8 Adding Modbus RTU Connectivity](#)
- [9 CODESYS Vizualisation](#)

1 Software Requirements

The following software packages are required throughout this document and can be accessed via the following links:

- CODESYS Runtime: this is the PLC Runtime installed on the Pageant CPU Module supplied by BEKA. Note that the runtime is already licensed so no activation is required.

The Runtime version installed can be accessed via the configuration menu. Refer to the Pageant Operator Panel System Instructions for details of the menu structure to access this information. **Make note of the runtime version supplied as the version of the CODESYS V3 Development System and the CODESYS Package below need to match.**

The Runtime includes the TargetVisu component to design custom screens and the Modbus RTU Fieldbus stack. Note that the BA3202 CPU Module needs to be purchased to implement Modbus RTU communication.

- The relevant version of the CODESYS Control for Pageant package can be downloaded from https://www.beka.co.uk/pageant_codesys_files.html
- The relevant version of the CODESYS V3 Development System can be downloaded from the Codesys website at (<https://store.codesys.com/en/codesys.html>)

2 CODESYS V3 Development System Installation


CODESYS V3 Development System software must be used to develop applications on the BEKA Pageant Operator Panel. Once the software is downloaded, follow the on screen instructions to complete the installation.

3 BEKA CODESYS Package Installation

A dedicated CODESYS Package is required to configure the Development System to work with the BEKA Pageant Operator Panel. Once you have downloaded the latest package from the BEKA website, double click on the .package file and the installation procedure will start automatically. The package contains:

- A BEKASyle Visualization Style: this restricts the colours available in the Visualization elements to the 4 levels of gray supported by the Operator Panel
- The CPU Module and Pageant Operator Panel Device Descriptions
- A BEKA project template to get up and running with the Visualization preconfigured and the Devices inserted in the project Device Tree

Once installed you can start the CODESYS Development System select Tools > CODESYS Installer to check that the Package has been installed. The package should appear in the list of installed packages:

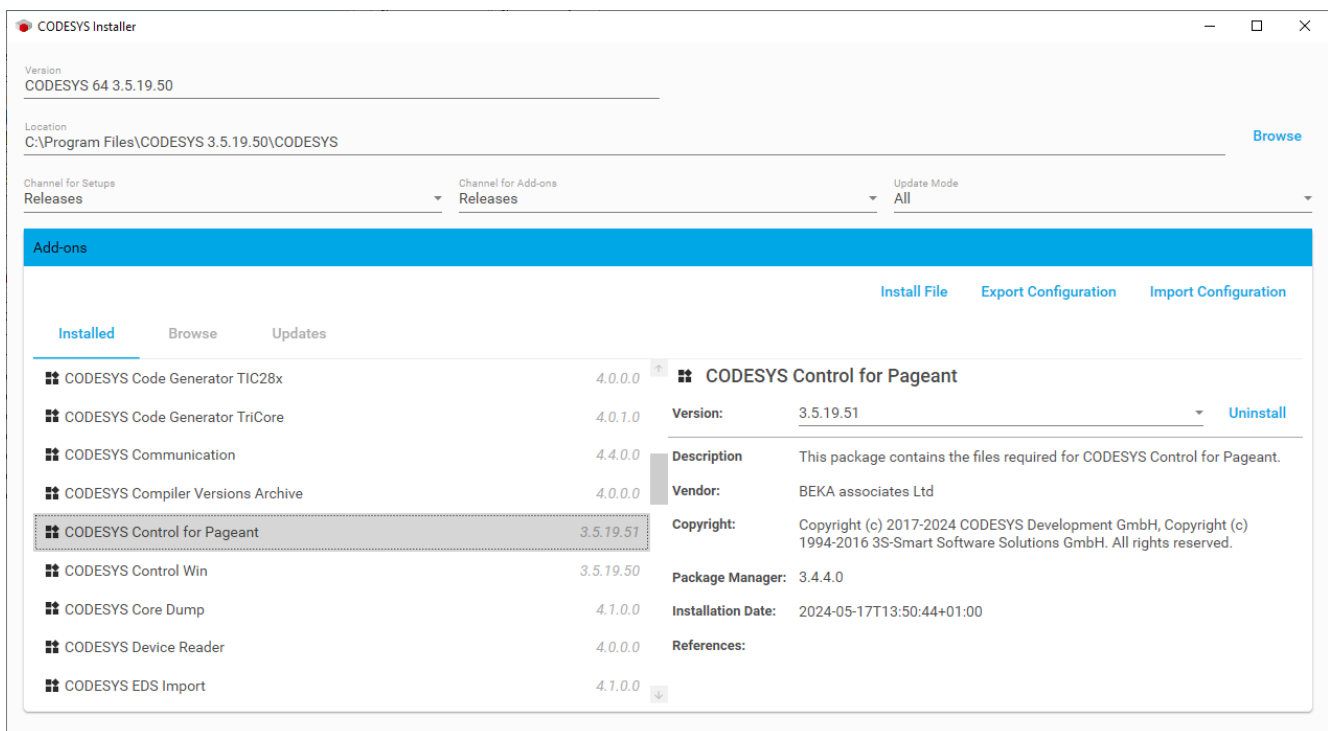


You can use the CODESYS Installer to Uninstall or Install the Package when a new version becomes available.

4 Creation of a new PLC Project


To create a new CODESYS project select File > New Project

Select the “Standard BEKA project”, enter the project name and location then press OK.

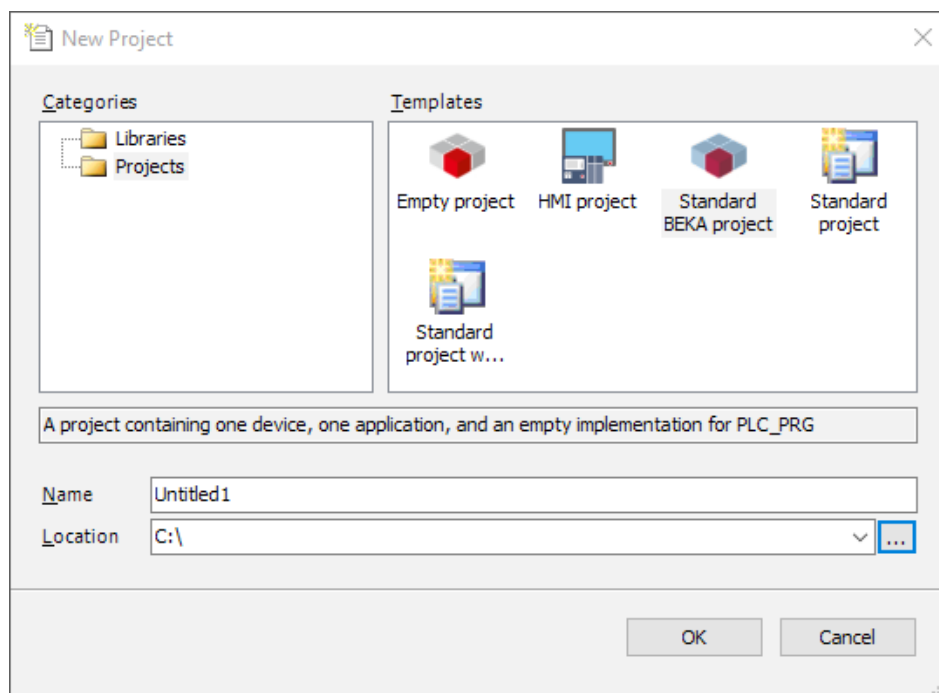

Note that the project will open with 2 default task, a cyclic MainTask calling the POU PLC_PRG every 100ms and the a VISU_TASK handling all visualization updates every 100ms.

The PLC_PRG POU is created by default using the Structured Text IEC language, to change this simply delete the PLC_PRG POU in the Device Tree and insert a new POU under the application.

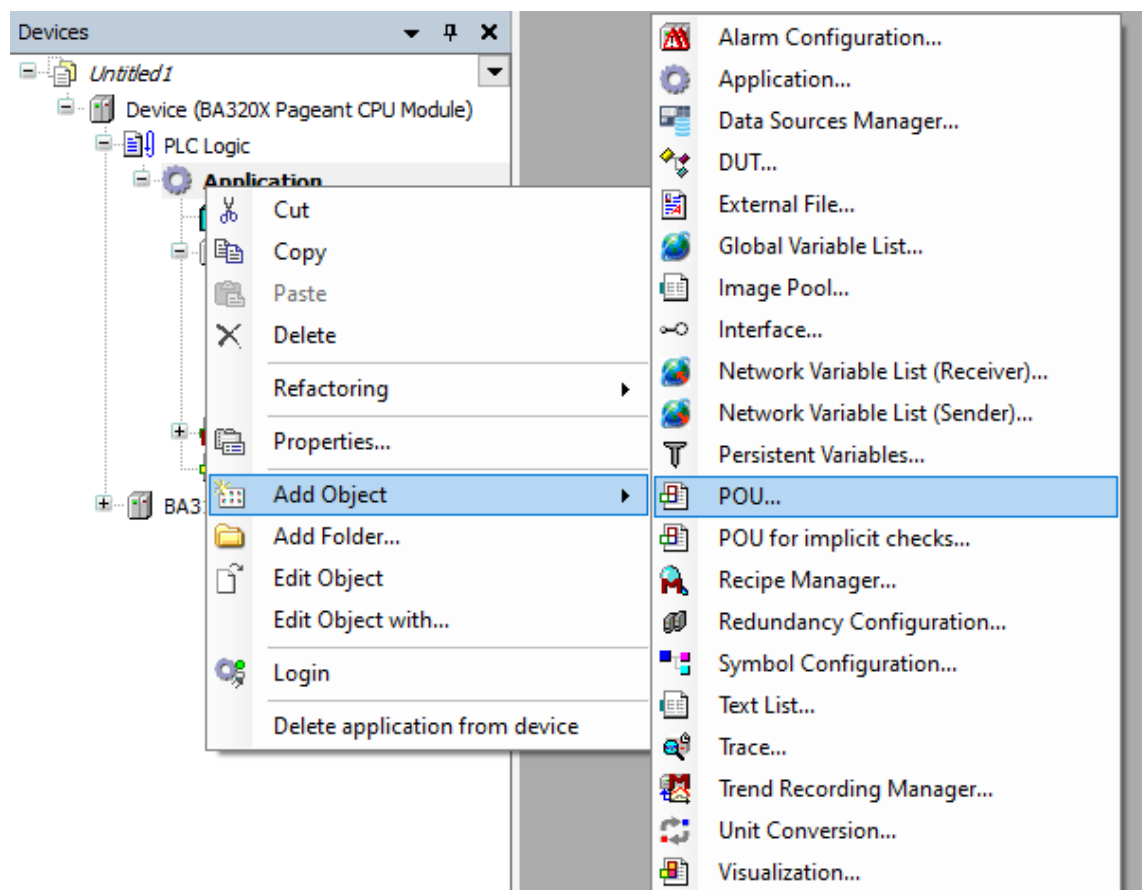

A new PLC_PRG POU can then be created and the implementation IEC language of choice can be selected at the bottom.

Add POU

 Create a new POU (Program Organization Unit)

Name

PLC_PRG

Type

☒ **Program**

☐ **Function block**

☐ Extends

☐ Implements

☐ Final

☐ Abstract

Access specifier

Method implementation language

Structured Text (ST)

☐ **Function**

Return type

Implementation language

Structured Text (ST)

Continuous Function Chart (CFC)

Continuous Function Chart (CFC) - page-oriented


Function Block Diagram (FBD)

Ladder Logic Diagram (LD)


Sequential Function Chart (SFC)

5 Adding I/O Modules to the project


Expand the BA3101_Pageant_Operator_Panel in the Device Tree to show the I/O Modules slots.

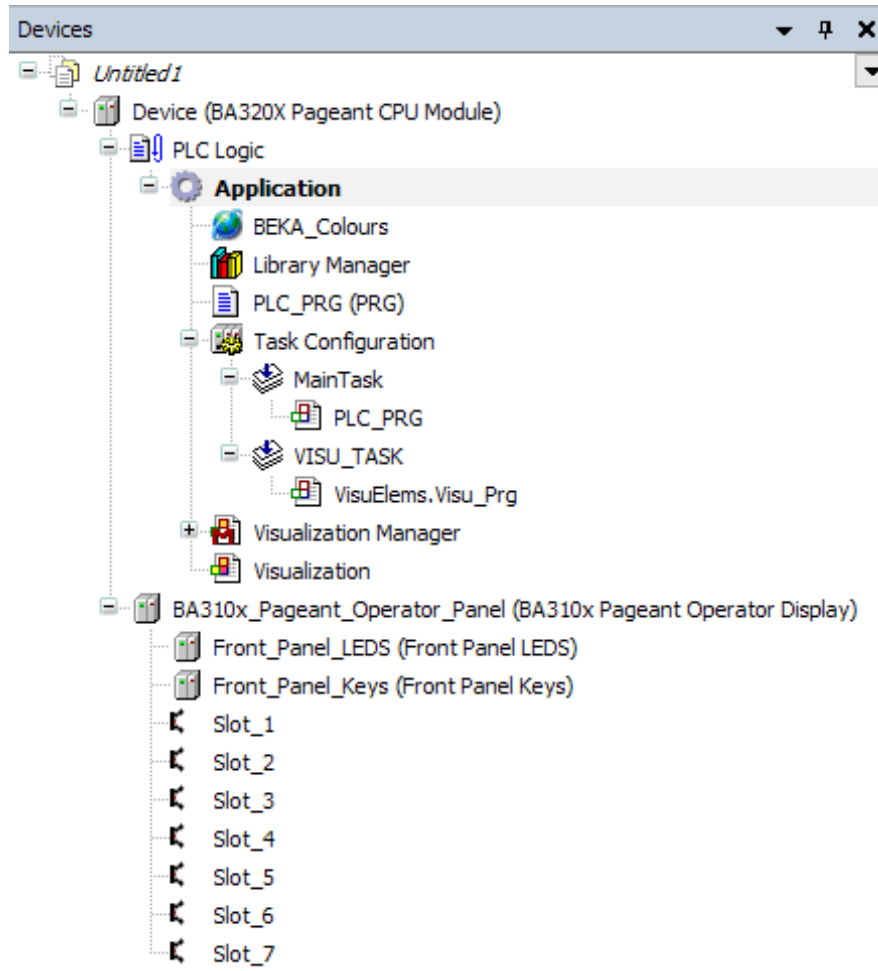

I/O Modules can be added under the BA310x Pageant Operator Panel device, right click on any of the 7 slots corresponding to the slots on the rear panel of the BA310x Display and select Plug Device. A list of all the I/O modules available will appear, select the Module required for the application and click on Plug Device.

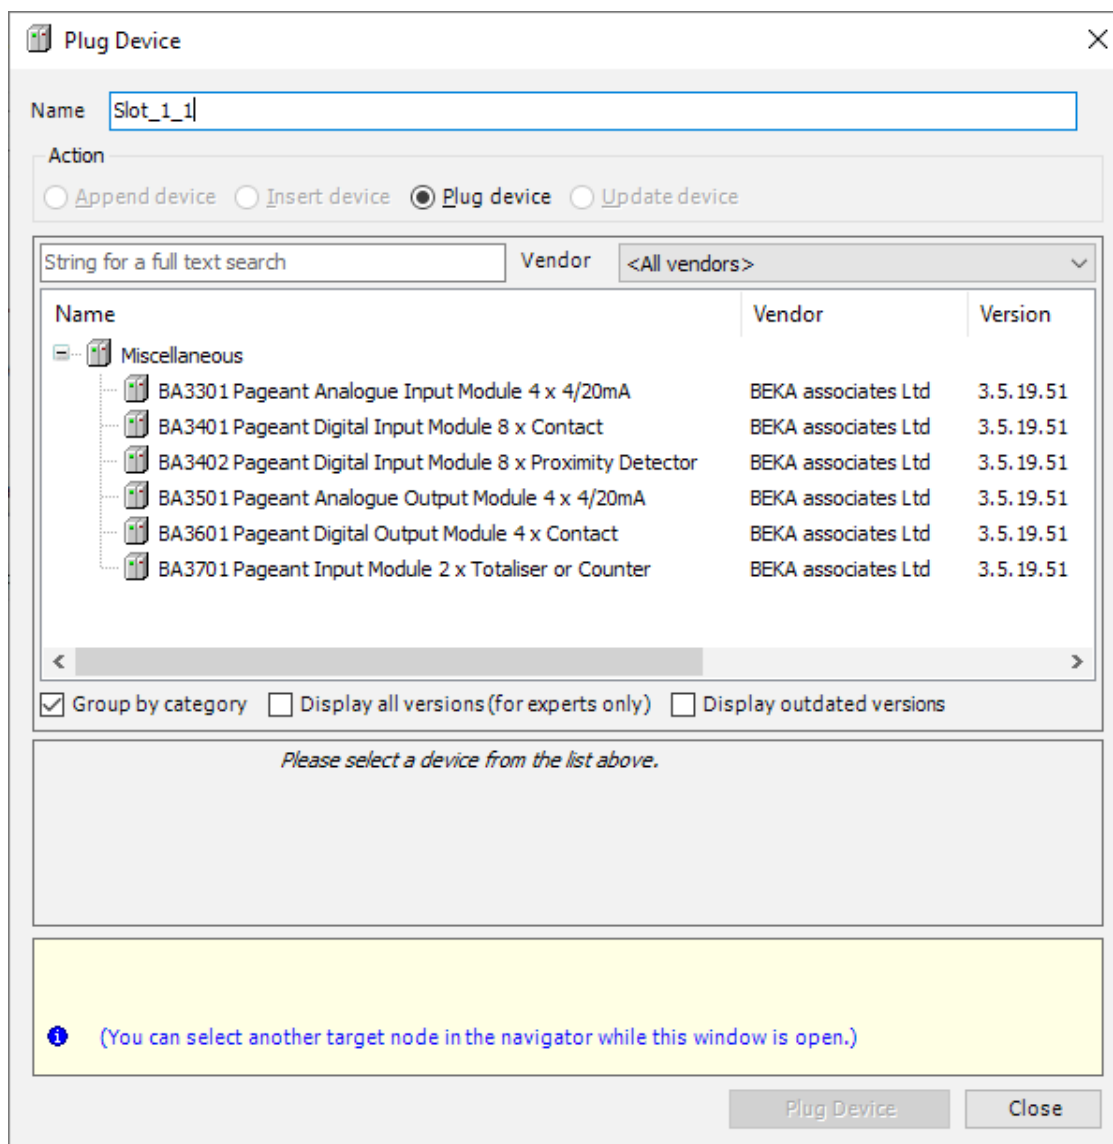

The device will now appear in the corresponding slot of the Device Tree. If you double click on the module, you will have access to the Module parameters (Serial Number, Module Number,...), the I/O map where the inputs and outputs for the module can be mapped to program variables.

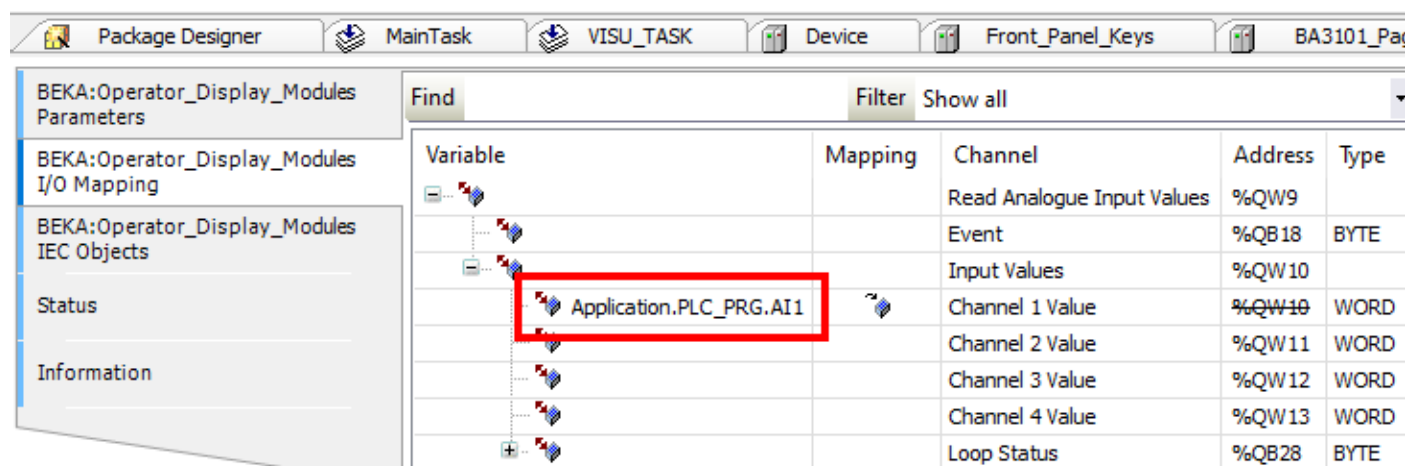

6 Display Keys and LEDs


The Front_Panel_LEDs and Front_Panel_Keys devices also appear under the BA310x_Pageant_Operator_Panel, these will give control of the touch buttons and front LEDs of the Pageant Display in a similar manner to the I/O modules.

7 Downloading PLC applications


To download PLC applications to the Pageant Operator Panel, you will need the BA3902 Pageant USB Programming Cable

Connect it to your PC 's USB port, the driver should be installed automatically. This cable emulates a serial port, the first thing to do is to find out the COM port number allocated to this cable. Press the Windows Logo Key and type Device Manager.


The USB Serial Port should be present under Ports (COM & LPT), make note of the COM port number (COM4 in this example):

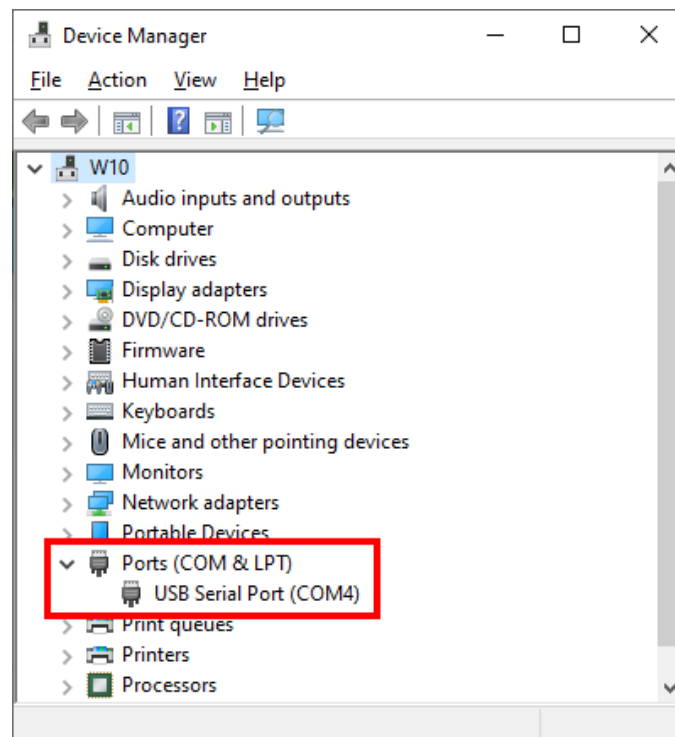

In the CODESYS Development Environment, double click on the Device (BA3201 Pageant CPU Module) in the Device Tree on the left hand side, the Communication Settings window will appear:

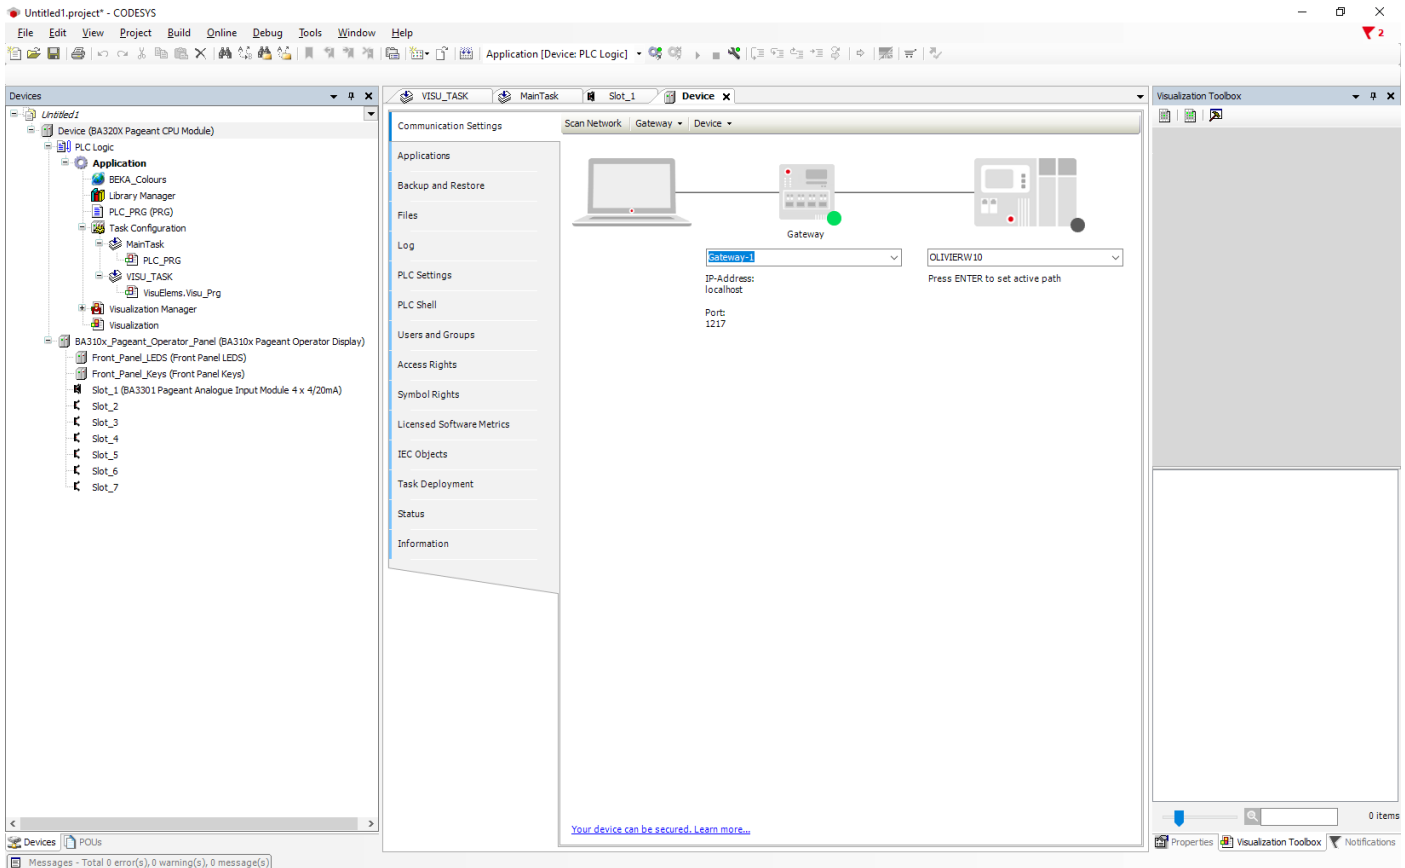


Select Gateway > Configure Local Gateway, add a New Top Level Interface as a COM port. Ensure the settings are set as below, amending the Name, Port and Local Address to match with your COM port number:

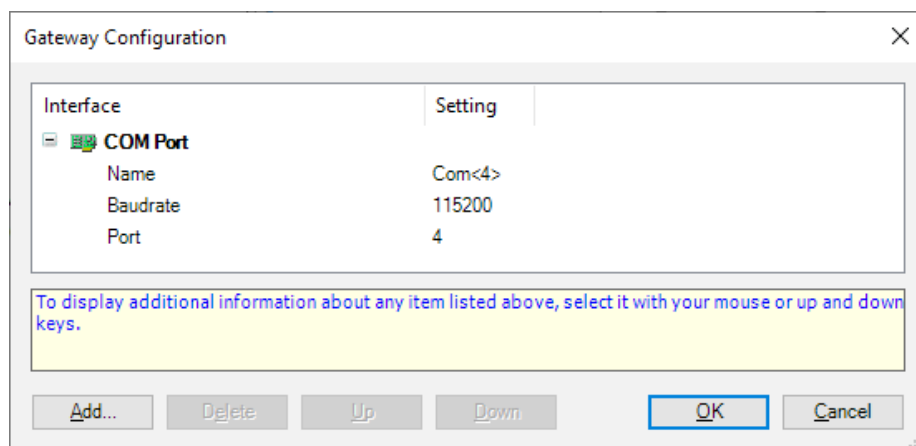


Confirm by clicking OK.

Connect the other end of the BA3902 to the programming port SK3 on the Pageant CPU Module.


Power up the Pageant Operator Panel and ensure the system has reached the point where the Codesys Runtime has started which is indicated by an Amber or Green Status LED on the Display.

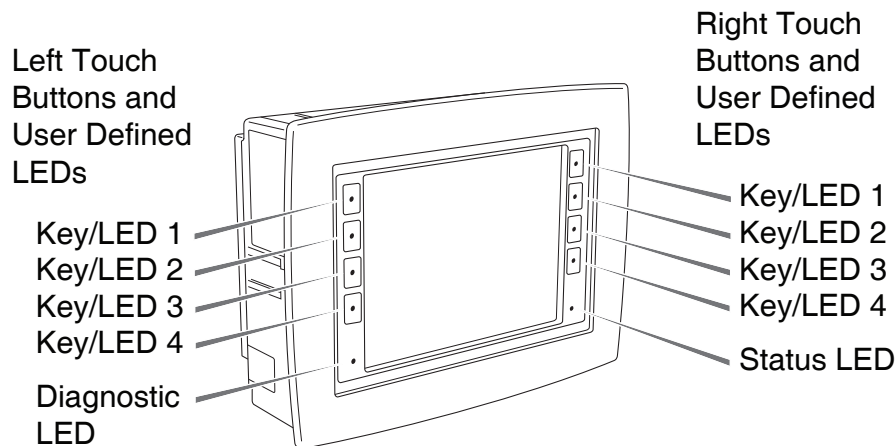


Once the Gateway configuration has been changed, the Codesys Gateway needs to be restarted for the change to take effect. Find the Codesys Gateway in the Windows System Tray, right click and select "Stop Gateway". Then Right Click again and select "Start Gateway".

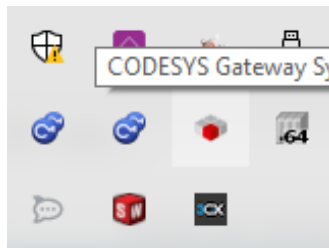

On the CODESYS Communication Settings window, select Scan Network, the BA3201 CPU Module should appear under the Gateway:

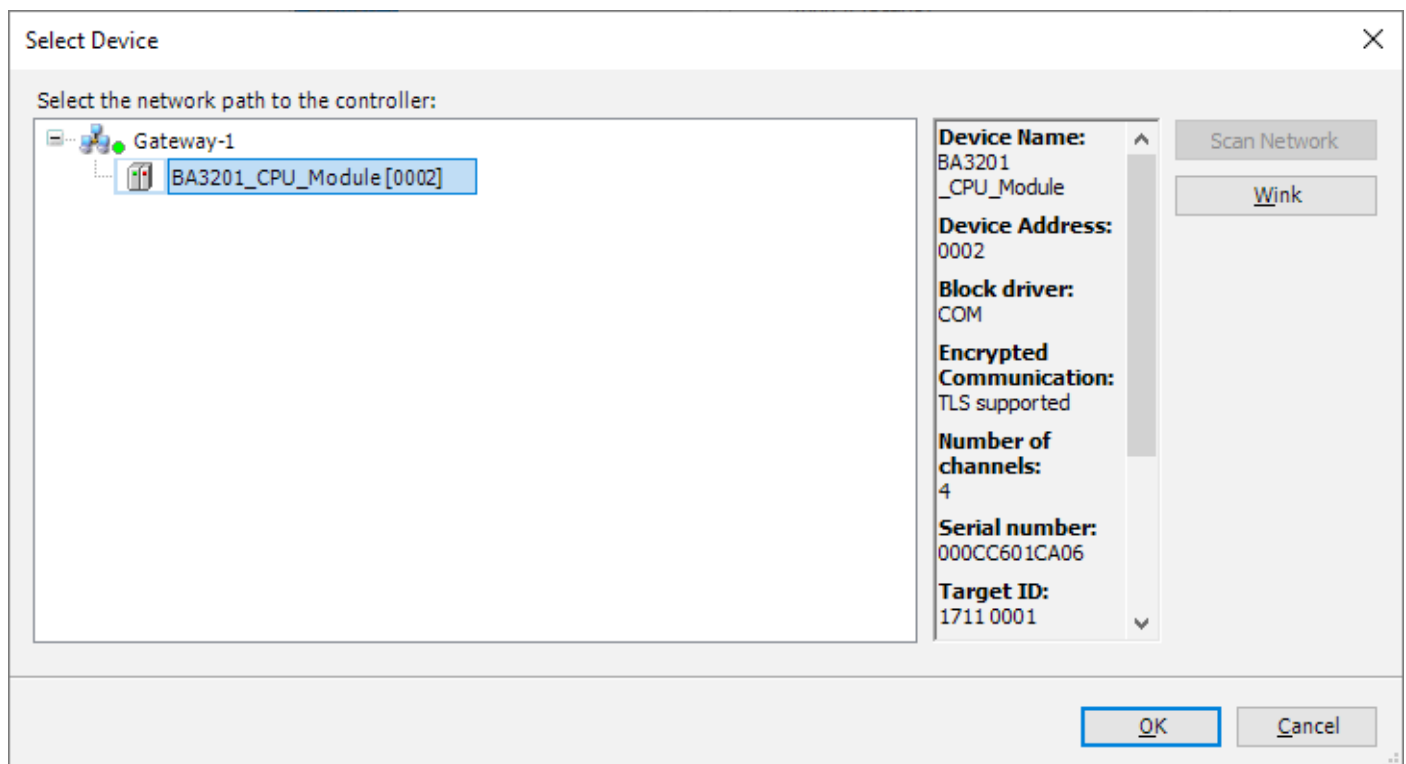

Select the CPU Module and validate with OK, you will now have a green LED on the device confirming you are connected to the Pageant CPU.

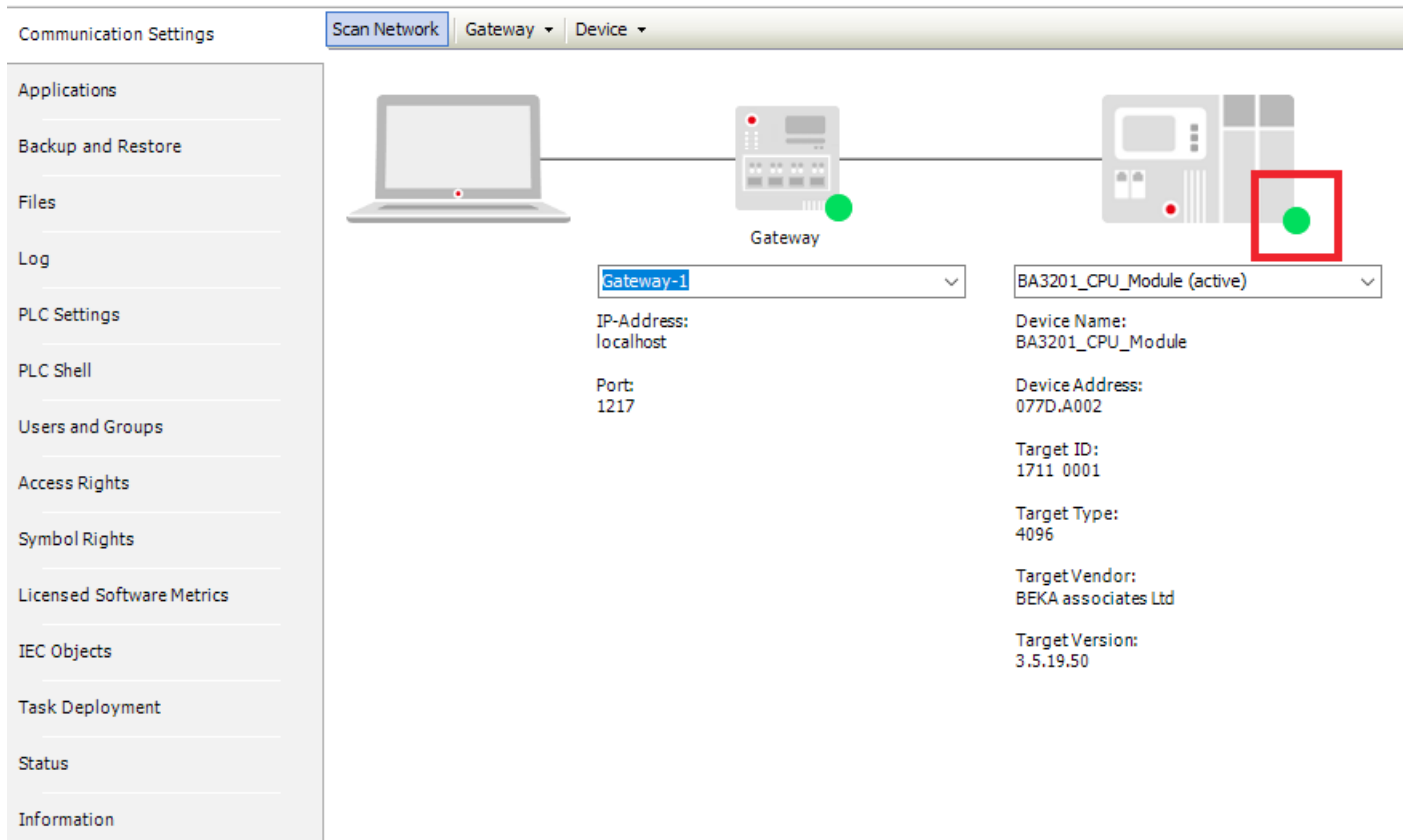


You can now Download and Debug IEC applications to the Pageant Operator Panel.

8 Adding Modbus RTU Connectivity

To add Modbus RTU Connectivity to the IEC application, right click on the Pageant CPU Module at the top of the device tree and select Add Device...


An "Add Device" window will appear, select
Fieldbuses > Modbus > Modbus Serial Port > Modbus COM

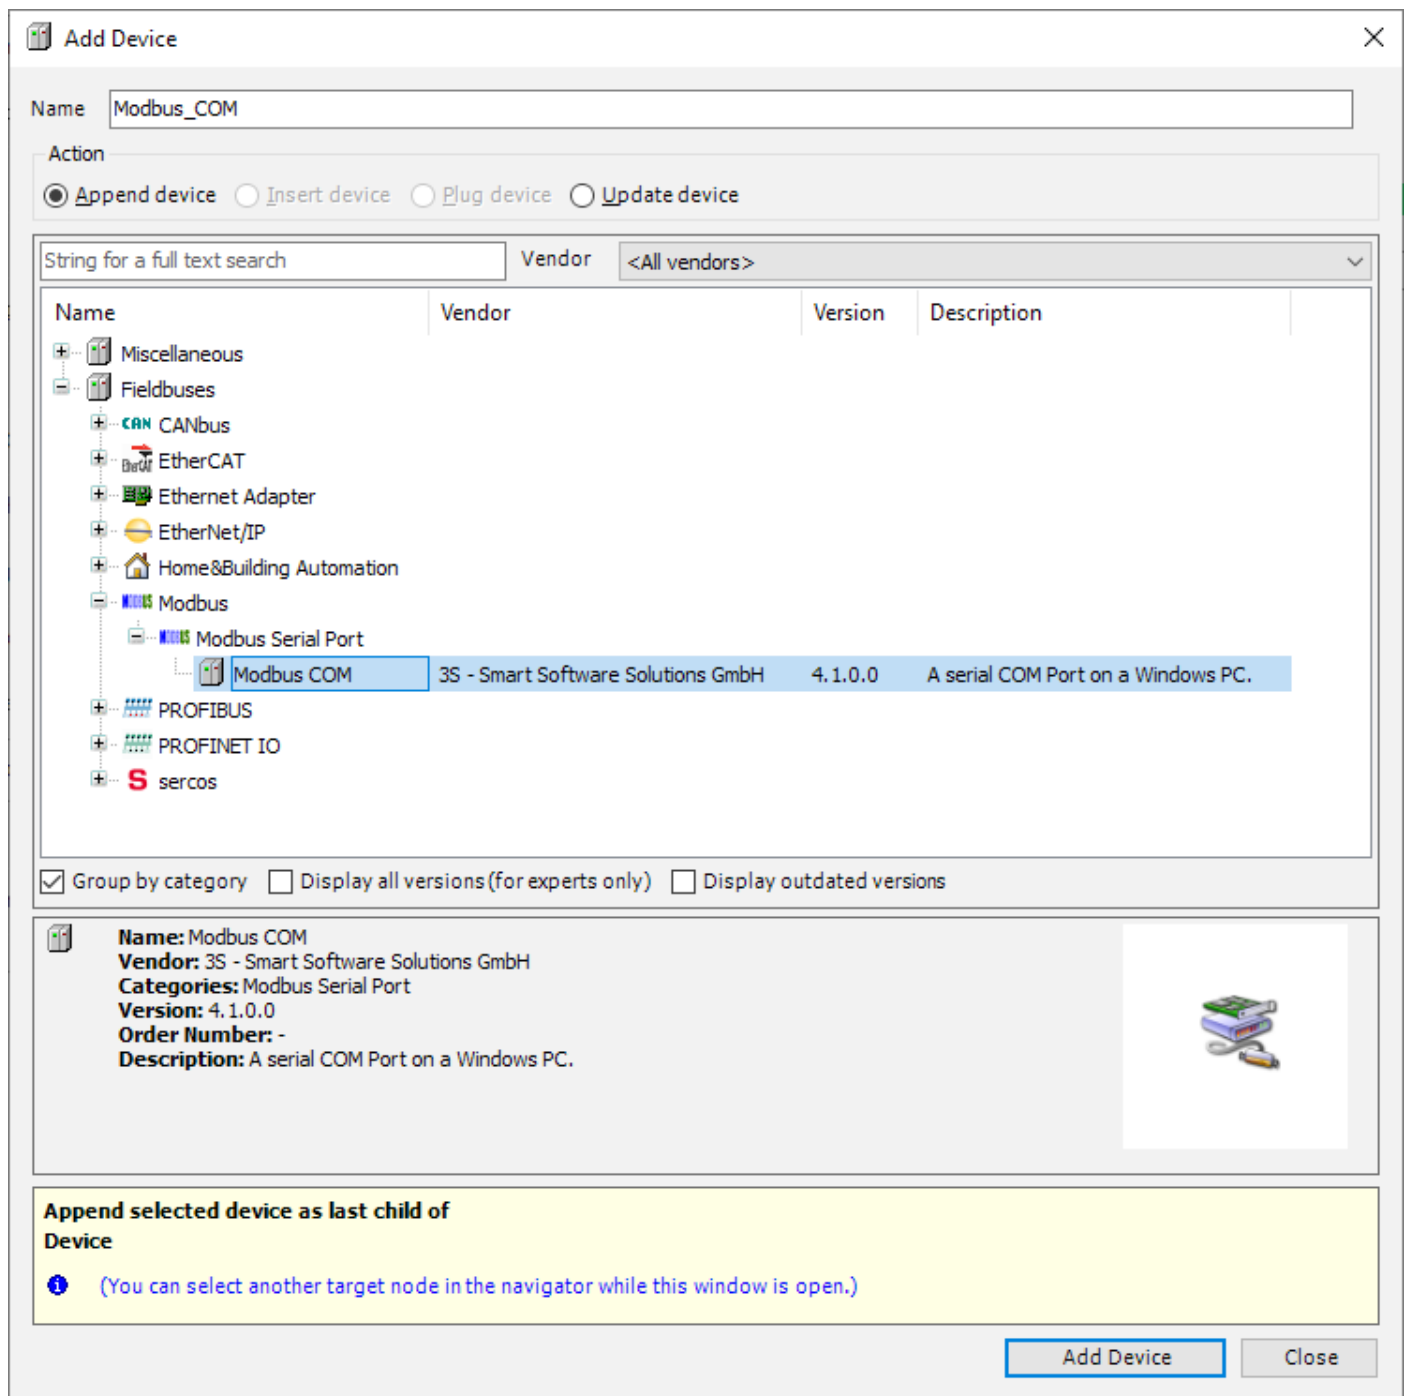

Confirm by Clicking on Add Device. A Modbus_COM device now appear in the Device tree on the left hand side. Double Click on this new Device and select the General tab which will display the Serial Port Configuration. **The COM port always needs to be selected as 1**, this is the port allocated inside the CPU module to Fieldbus communications. The other settings (Baud Rate, Parity, Data Bits and Stop Bits) need to match the settings of the other devices on the bus.

Right Click on Modbus_COM in the Device Tree, you can then add either a Modbus Serial Device if the Pageant Operator Panel is a Modbus Slave or Modbus Serial Master if the Pageant Operator Panel is a Modbus Master.


For further details on how to configure the Modbus communications with other devices, please refer to the CODESYS Development System documentation under Fieldbus Support.

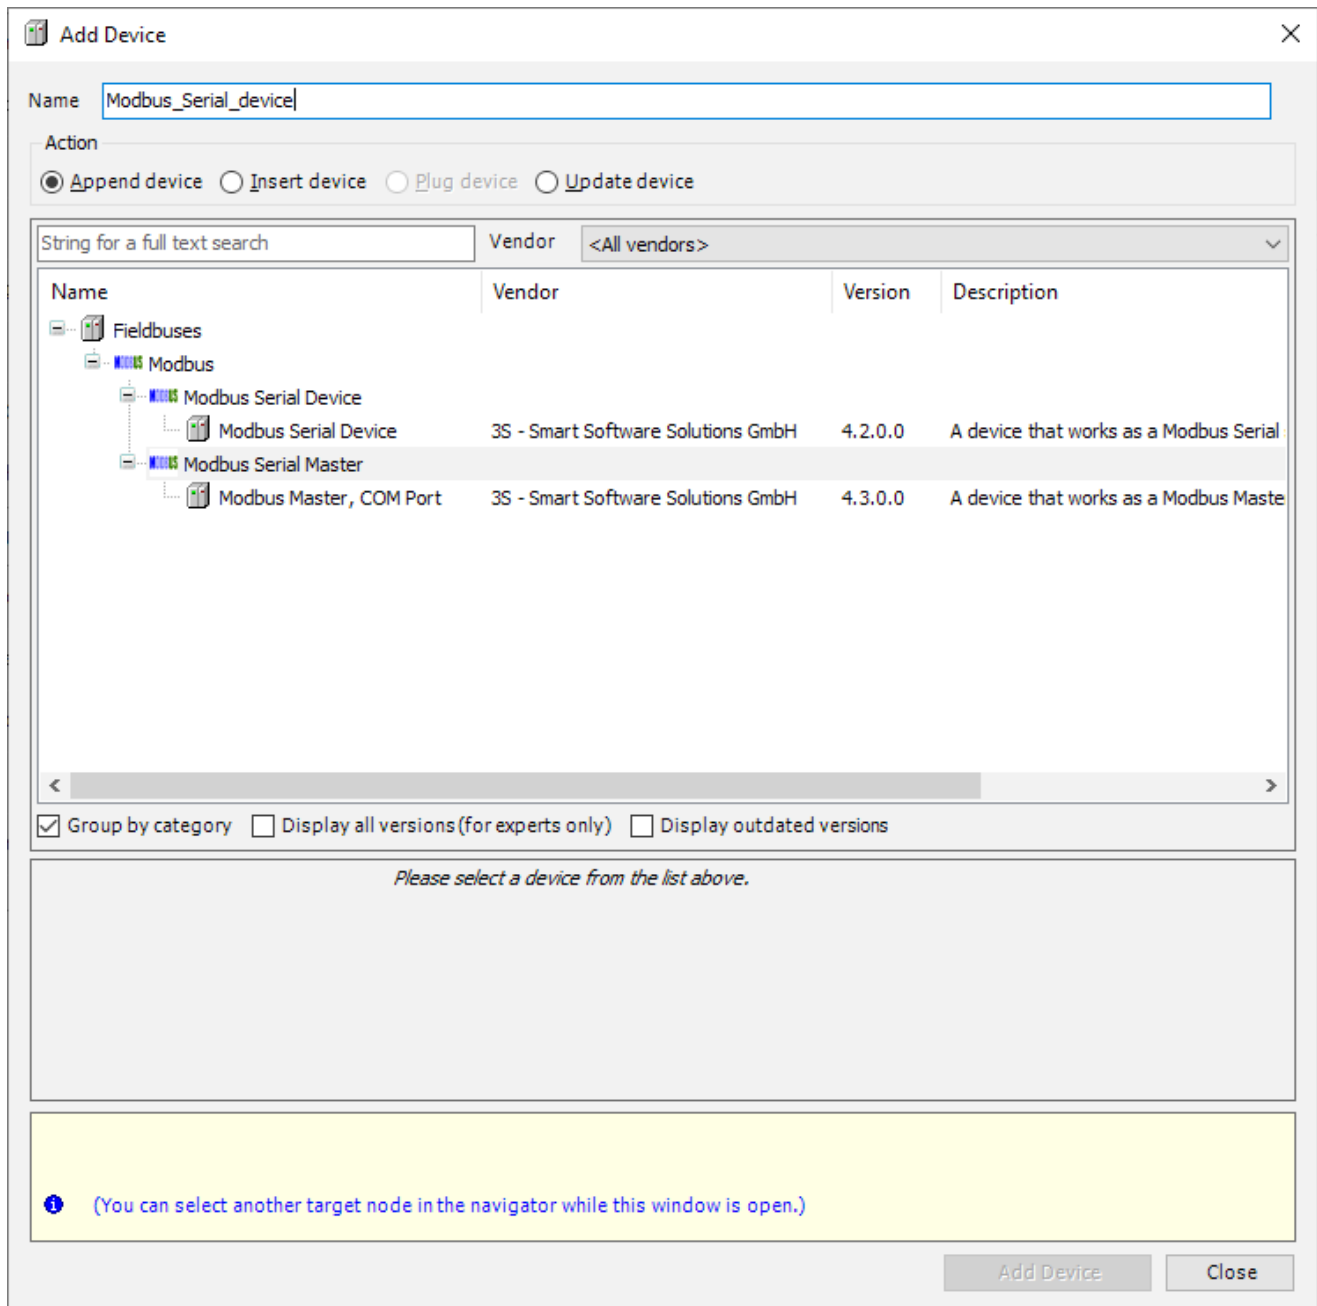

9 CODESYS Visualization

The CODESYS runtime on Pageant includes the TargetVisu component which gives the ability to design graphical user interfaces.

In the device tree a Visualization screen is already inserted in the project by default. By double clicking on it you will see a blank screen.

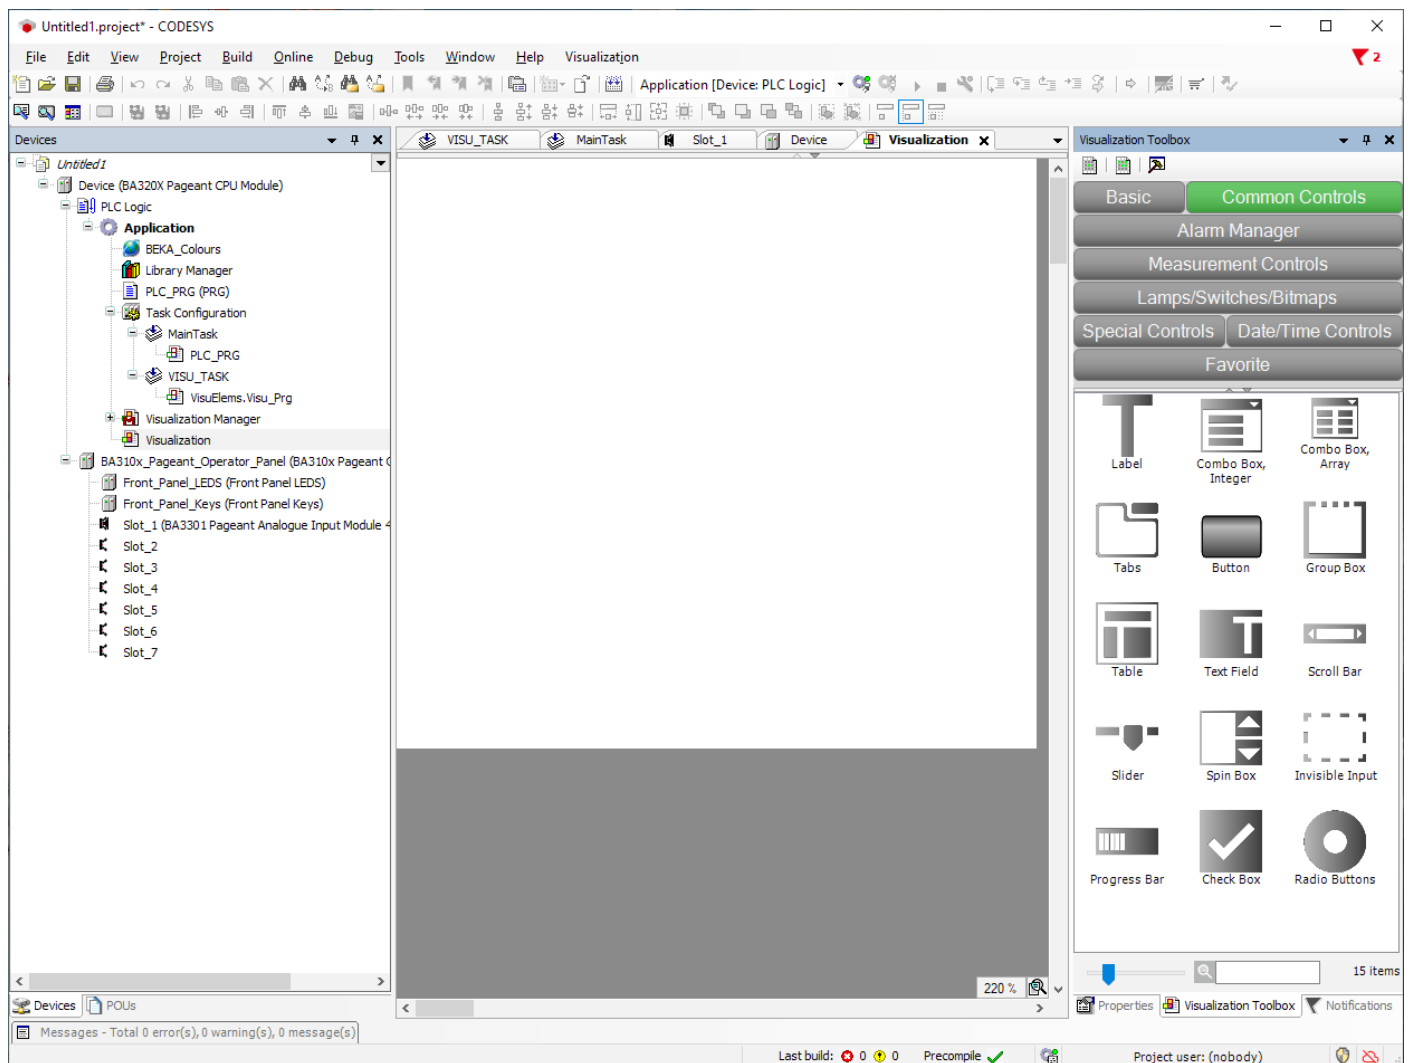

The screen sizes is already set up to 320 X 240 pixels to match with the LCD size of the Display and the fonts are restricted to the list of fonts available in the BA310x Display.

The Pageant CODESYS package includes a BekaStyle Visualization style which restricts the colours to the 4 greyscale available on the BA310x Display.

Elements from the Visualization Toolbox can be dragged and dropped on the screen to build the User Interface, Please refer to the CODESYS Visualization Help content for more information.

